




HIGHRIDGE WATER AUTHORITY

17 Maple Avenue
Blairsville, PA 15717
(724) 459-8033 (724) 459-5629 (fax)
highridgewater.org

RESIDENTIAL SERVICE CONNECTIONS (NEW & UPGRADED AS OF SEPT 2017)

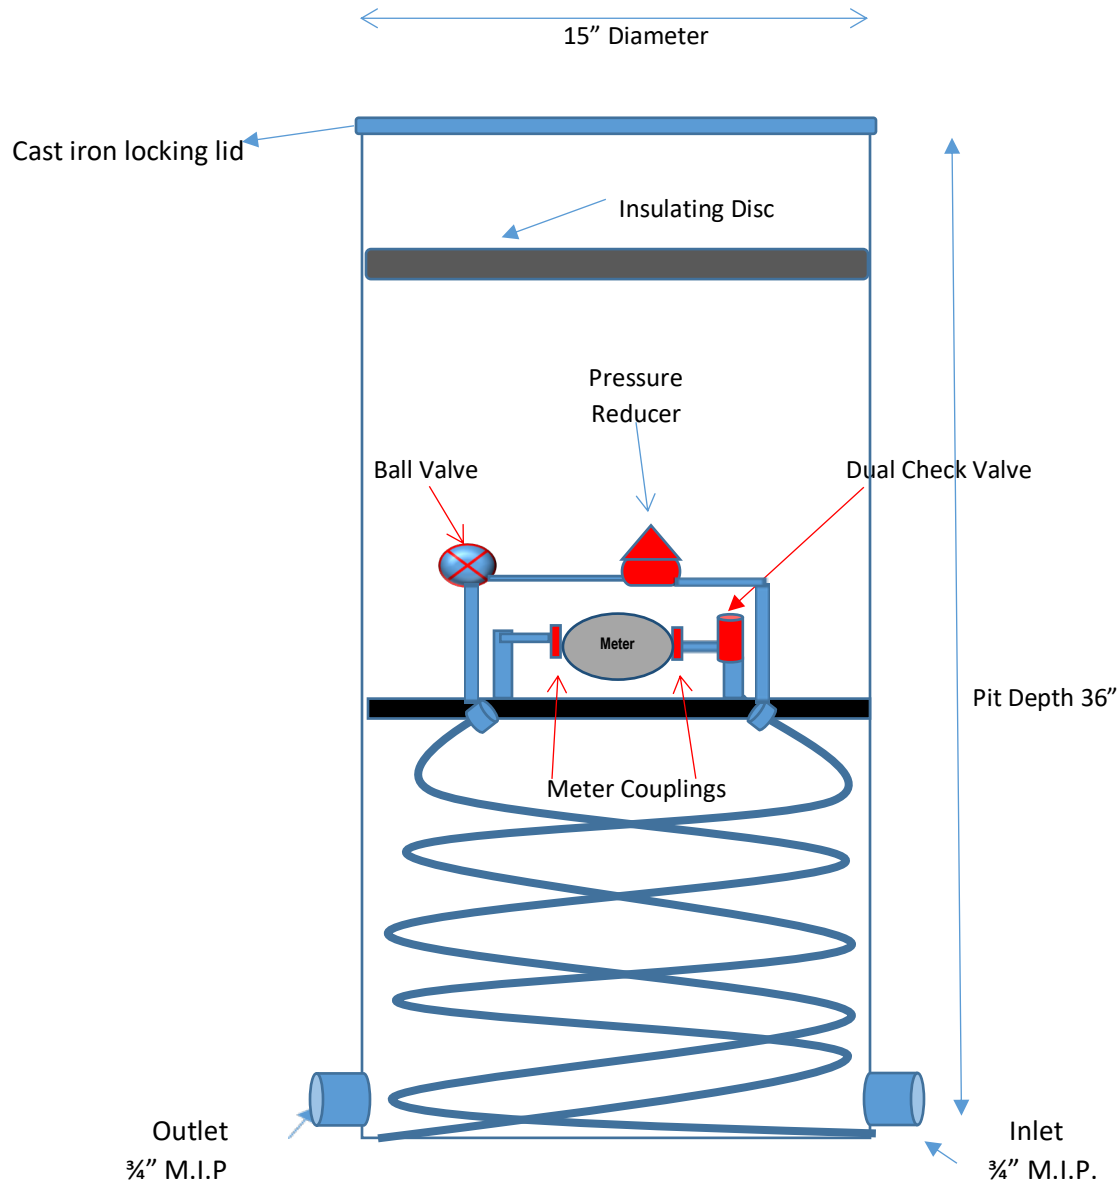

Tandem Coil Pit Setter

****All commercial customers must have testable ASSE certified check valves****

Refer to Rules & Regulations Pamphlet for detailed specifications



Highridge Water Authority


17 Maple Avenue

Blairsville, PA 15717

(724) 459-8033 724-459-5629 (FAX)

www.highridgewater.org

Alternate Meter Pit Diagram – For experienced Plumber Only
FOR USE ONLY WHEN PIT CAN BE INSTALLED NO DEEPER THAN 3-FEET

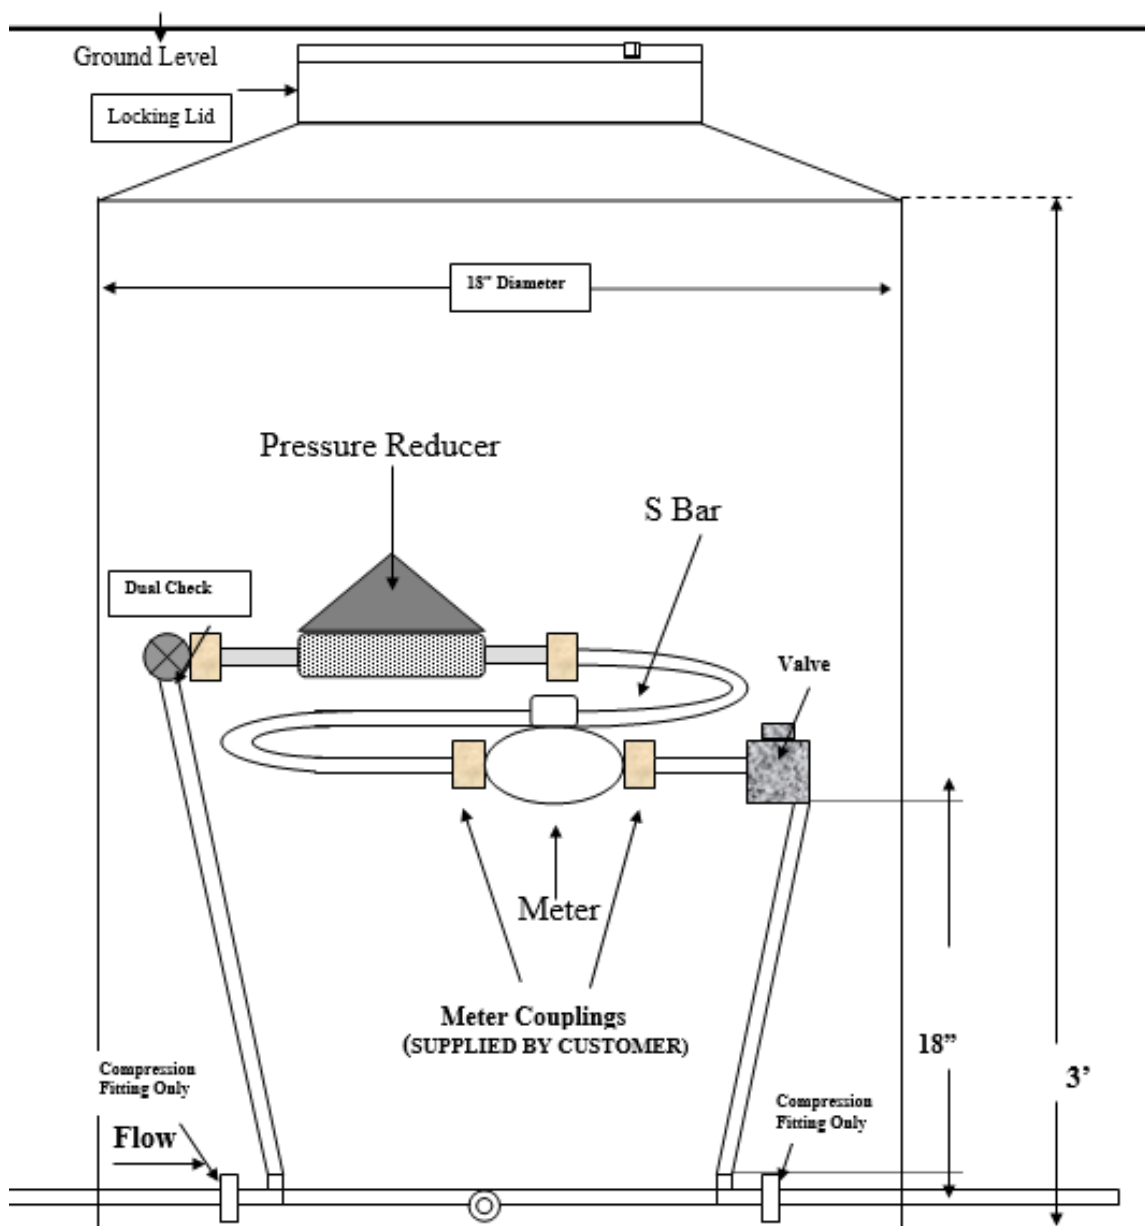


Alternate METER PIT Diagram – For Experience Plumbers Only
Ford 70 series Copper Setter (18") w/ Dual Check Valve & Pressure Regulator
Refer to rules & regulations Pamphlet for detailed specifications.



Highridge Water Authority
17 Maple Avenue
Blairsville, PA 15717
(724) 459-8033 724-459-5629 (FAX)
www.highridgewater.org

PRE-EXISTING CONNECTIONS (as of Sept 2017)
not applicable for new connections

Residential Service

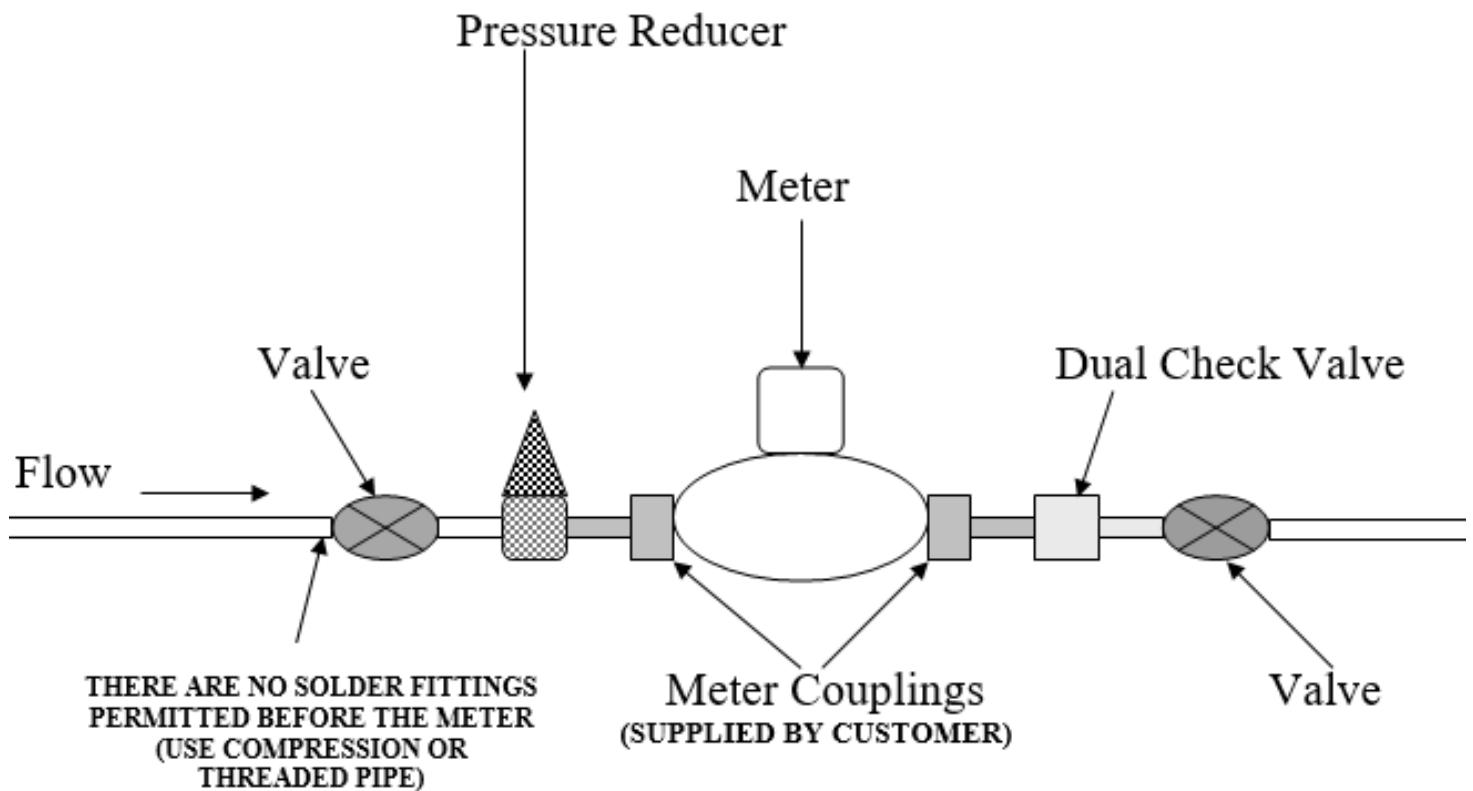

Inside Meter Setting- 3/4"

Meters located inside buildings must be in a sanitary, temperature-controlled environment and the Authority may revoke this status at any time and require installation of an exterior meter pit.

Refer to Rules & Regulations Pamphlet for detailed specifications